
ST-HF-LR-02



Brick Beam Lintel Repair System

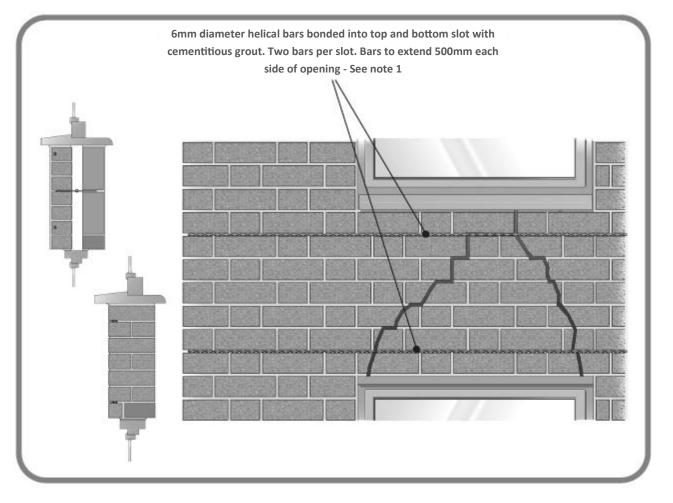

METHOD STATEMENTS & NOTES

1. Remove section of mortar to full height in two separate bed joints. Flush with clean water and bond a pair of 6mm helical bars, 10mm apart, using cementitious grout. Make good joint to match existing.

Depth of the slots should be 40mm on a half brick single leaf and 55mm on a full brick solid leaf. Treat thicker walls from both sides.

Ratio between span of opening and distance between top and bottom reinforcement should not exceed 7:1

REINFORCEMENT SPECIFICATION

- Material:
- Ult.Tensile Strength:
- 304 Series Stainless Steel
- Nominal CSA:
- 1050-1200N/mm²
- 6mm Bar = 7.4mm²

55N/mm²

 $5N/mm^2$

 $12N/mm^2$

 $13N/mm^2$

GROUT SPECIFICATION AT 28 DAYS

- Compressive Strength:
- Tensile Strength:
- Flexural Strength:
- Youngs Modulus:

Engineers, surveyors and contractors should refer to BRE Good Building Guide 62 and the BRE Load Tables for retrofit masonry beams formed by helical bars set in cementitious grout.